


# two $\pi$ Tower

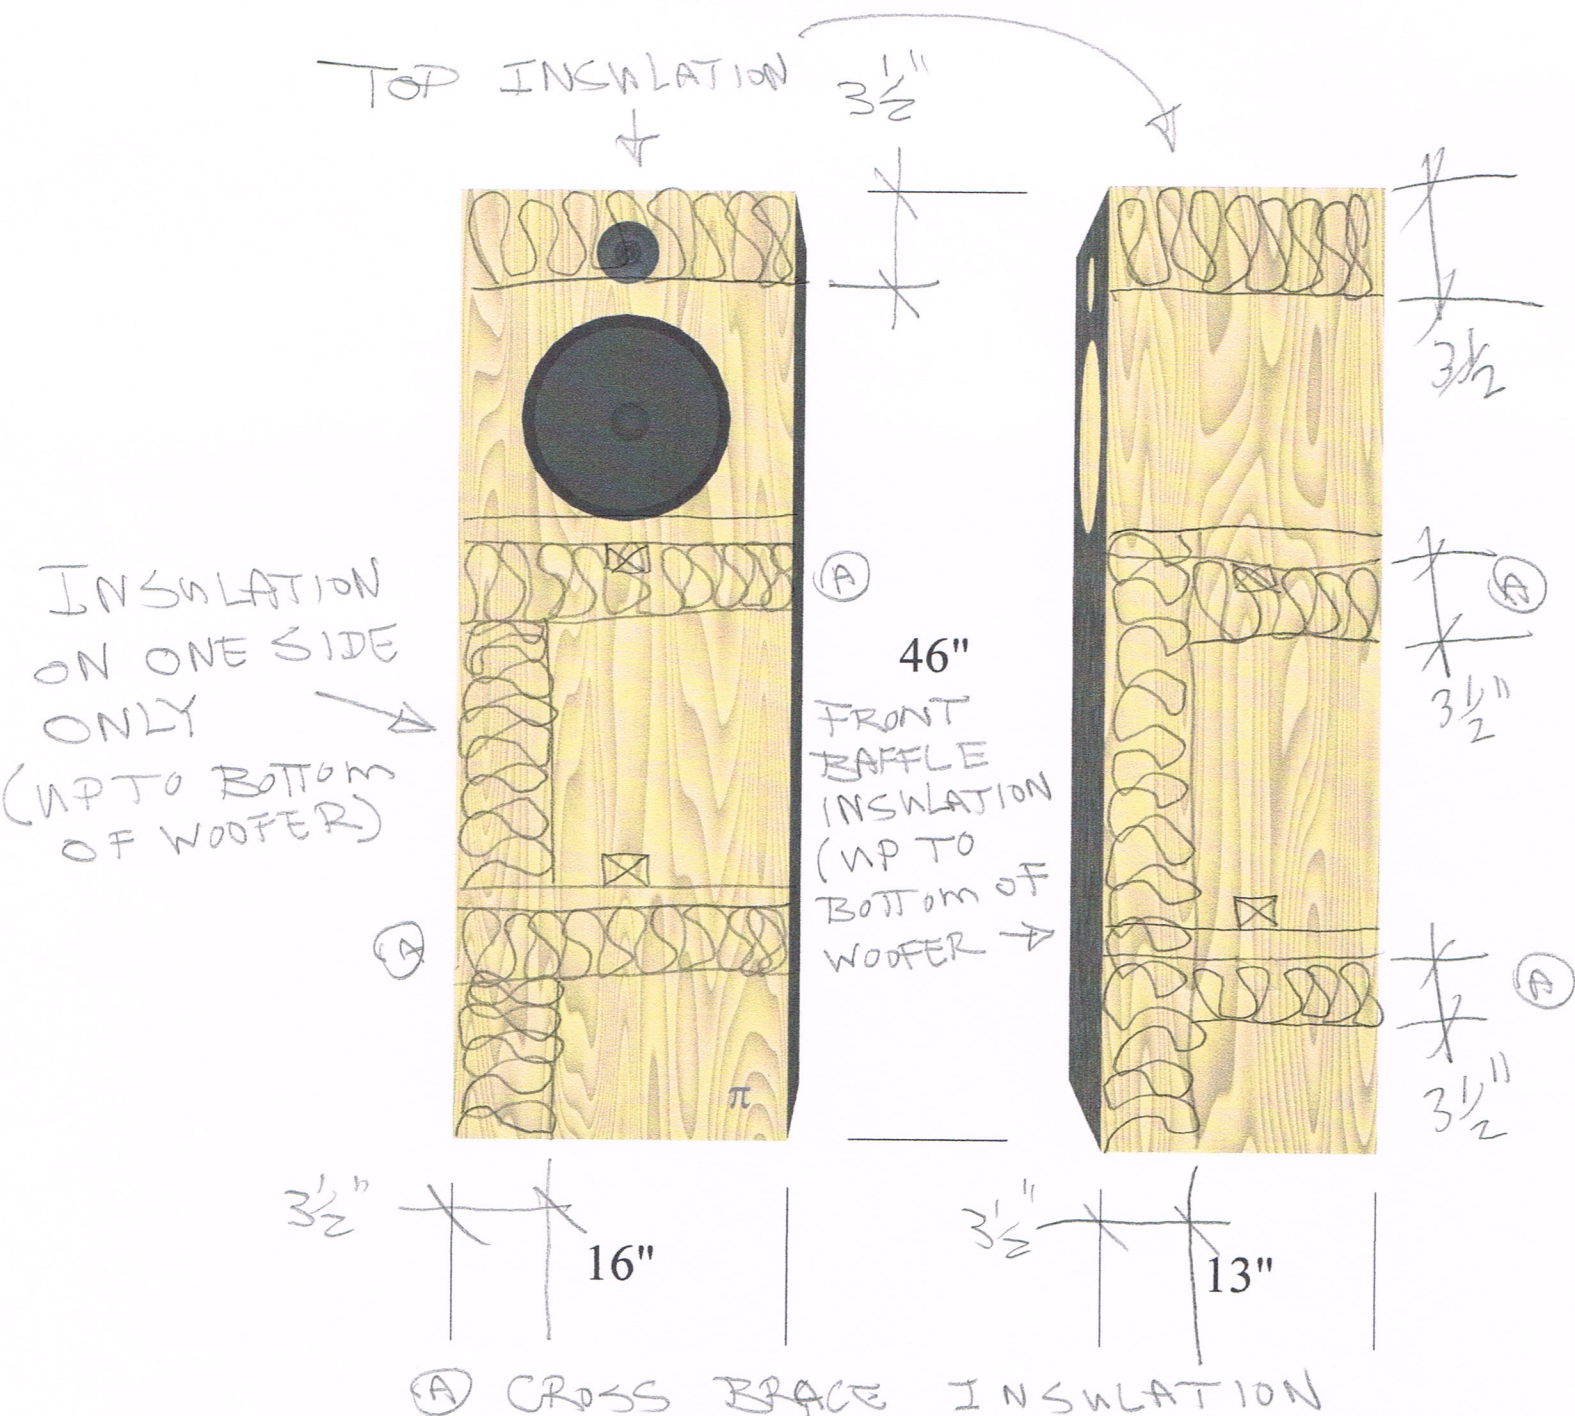

All panels are  $\frac{5}{8}''$  stock

Note:  $\frac{3}{4}''$  wood stock may be used instead, but if this is done, the port must be made  $4\frac{5}{8}''$  diameter to compensate